

广州智光自动化有限公司

地址： 广州市黄埔区云埔工业区埔南路51号
电话： (020)32113398




02 公司简介

公司简介



资质荣誉

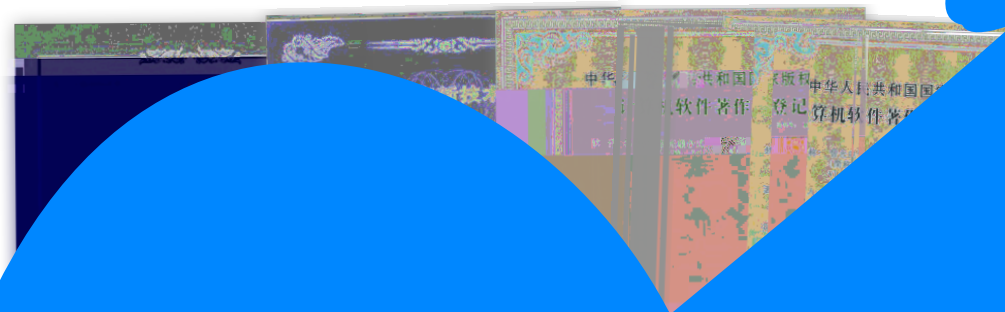




说明


	IDIN719S
	GB14287.2-2014 GB14287.3-2014
	8
	1
	0.52C
	85~265Vac
	<4VA
	<0.2%
	AC2kV/min~1mA ~ ~
	>100MΩ
	5kV1.2/50μs
	10 / 30 /1
	0-150C
	IDIN719S:3 4 IDIN719S4/8:3 4
	2 220Vac 25A%220Vdc 25%
	2 220Vac/5A,30Vdc/5A
	-10C~55C
	-25C~55C
	-40C~70C
	5%~95%
	90mm×90mm

由火灾探测器
≤ 0.3W
消防二总线
ZR-RVS-2x2.5mm ²
LED 指示
相对湿度≤ 95%
≤ 4500m





电压信号传感器

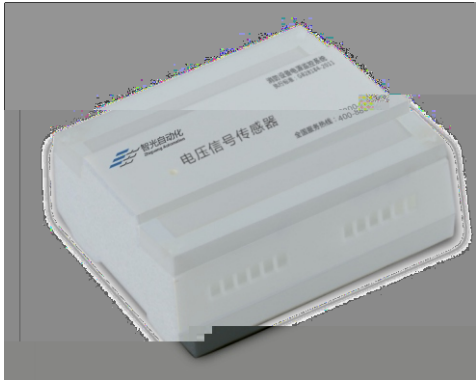

产品特点

- GB28184-2011
-
-
-
- DC24V
-
-

设计选型表

1	电压信号传感器	ZGU-K1	
2		ZGU-P1	
3		ZGU-P2	
4		ZGU-N1	
5		ZGU-N2	
6		ZGU-Z1	

技术参数

	DC10V-DC42V		
	0.3W		
+	ZR - RVSP - 2x 2.5mm²		+
	0~60s		
	110%,	85%	
	LED		
	AC0-500V		
	-20 ~+70		
	≤ 95%		
	4500m		
	IP42		
(× ×)	109mm×87mm×47mm		
	35mm		



电压/电流信号传感器



产品特点

- GB28184-2011
-
-
-
- DC24V
-
-

设计选型表

1	电压/电流信号传感器	ZGI-K	100: 5	1 ZT-T
2		ZGI-K2A	100: 5	1 ZT-T
3		ZGI-P	100: 5	3 ZT-T
4		ZGI-P2A	100: 5	3 ZT-T

-MB/ -MG防火门监控器主机

产品特点



设计

						X X mm	
						100A	51x46x18
2	电流探头	ZG	T400	Φ 45			
3		ZG	T1000	Φ 45			
4		ZG	Z100A				
5		ZG	S26			51x46	
6		ZG	S45		/	51x77	
7		ZG	S80	Φ 45	/		
		ZG	S100	Φ 100	/		
				100×36			
				200×80			

品特

-
-
-
-
-
-

技术参

Z--CK防火门

Z-S 防火门电机